
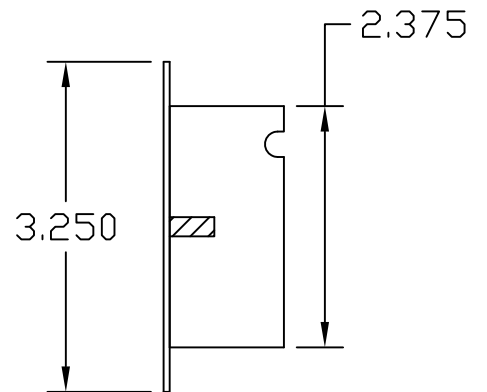
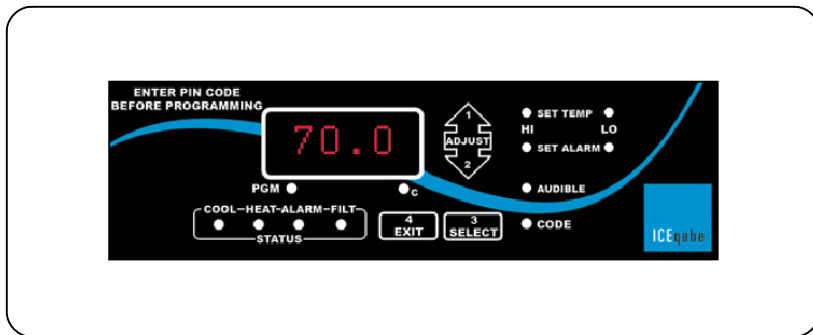


**PROPRIETARY DRAWING**

THIS DRAWING IS THE PROPERTY OF ICE QUBE, INC. AND IS NOT TO BE DUPLICATED OR ALTERED WITHOUT AUTHORIZATION OF ICE QUBE, INC.

**REVISIONS**

REV	DESCRIPTION	DATE	CHECKED
-----	-------------	------	---------

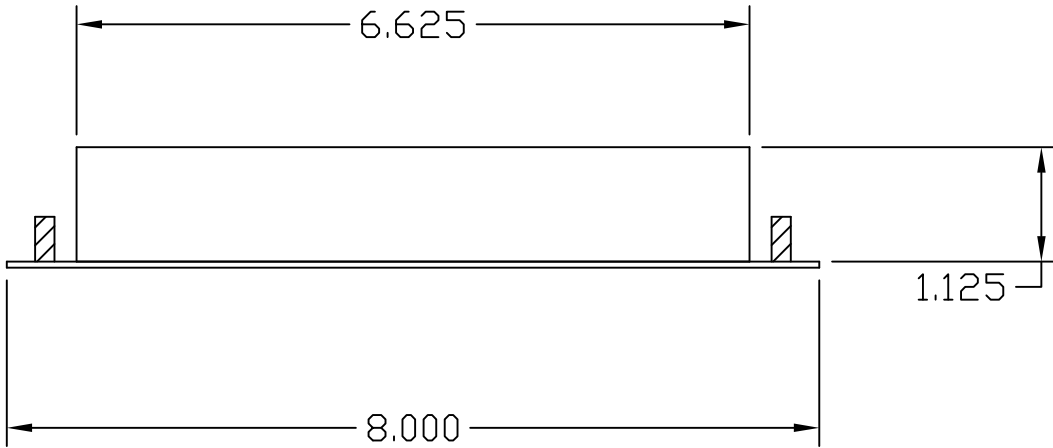



UNLESS OTHERWISE SPECIFIED TOLERANCES: .X ± .060" .XX ± .030" .XXX ± .015" ANG ± 1/2°			INDUSTRIAL COOLING EQUIPMENT 141 WILSON AVENUE GREENSBURG, PA 15601 724-837-2204 * 1-800-957-8234 FAX 724-837-3386	
PROJECTION DRAWN DATE SHEET 1 OF 1	 SCALE NONE 6-1-10		PART NAME REMOTE CONTROLLER	DWG NO IQ300527

**PROPRIETARY DRAWING**  
 THIS DRAWING IS THE PROPERTY OF ICE  
 QUBE, INC. AND IS NOT TO BE DUPLICATED  
 OR ALTERED WITHOUT AUTHORIZATION OF  
 ICE QUBE, INC.

REVISIONS			
REV	DESCRIPTION	DATE	CHECKED
1	REDRAWN - NO CHANGES, ADDED DWG #	3-18-05	JJH

1. ATTACH TEMPLATE TO ENCLOSURE SURFACE AT DESIRED REMOTE CONTROLLER LOCATION.
2. CUT A RECTANGULAR OPENING 2.750 X 6.880.
3. DRILL 2 HOLES .220 DIA.
4. APPLY GASKET TO THE CONTROLLER FLANGE TO MAINTAIN NEMA RATING.
5. INSERT THE CONTROLLER AND ATTACH TO ENCLOSURE USING TWO 10-32 NUTS.

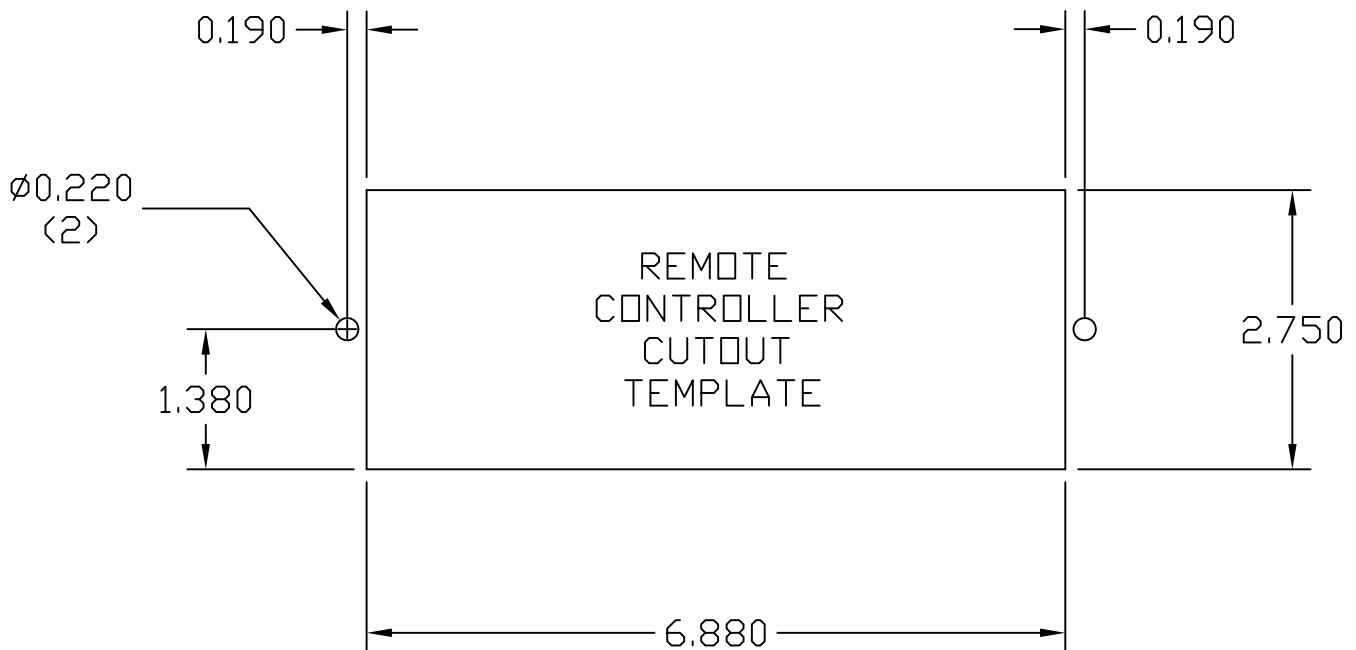

UNLESS OTHERWISE SPECIFIED TOLERANCES:		 INDUSTRIAL COOLING EQUIPMENT 141 WILSON AVENUE GREENSBURG, PA 15601 724-837-2204 * 1-800-967-8234 FAX 724-837-3386	
.X ± .060"	.XX ± .030"	PART NAME	
.XXX ± .015"	ANG ± 1/2°	REMOTE CONTROLLER	
PROJECTION	SCALE	CUTOUT TEMPLATE	
DRAWN	SCALE	DWG NO	REV
SJP	NONE	IQ250302	1
DATE			
4-05-00			
SHEET 1 OF 1			